VISITOR INFORMATION FOR

EMERGENCY PREPAREDNESS

AT THE

South Texas Project Electric Generating Station

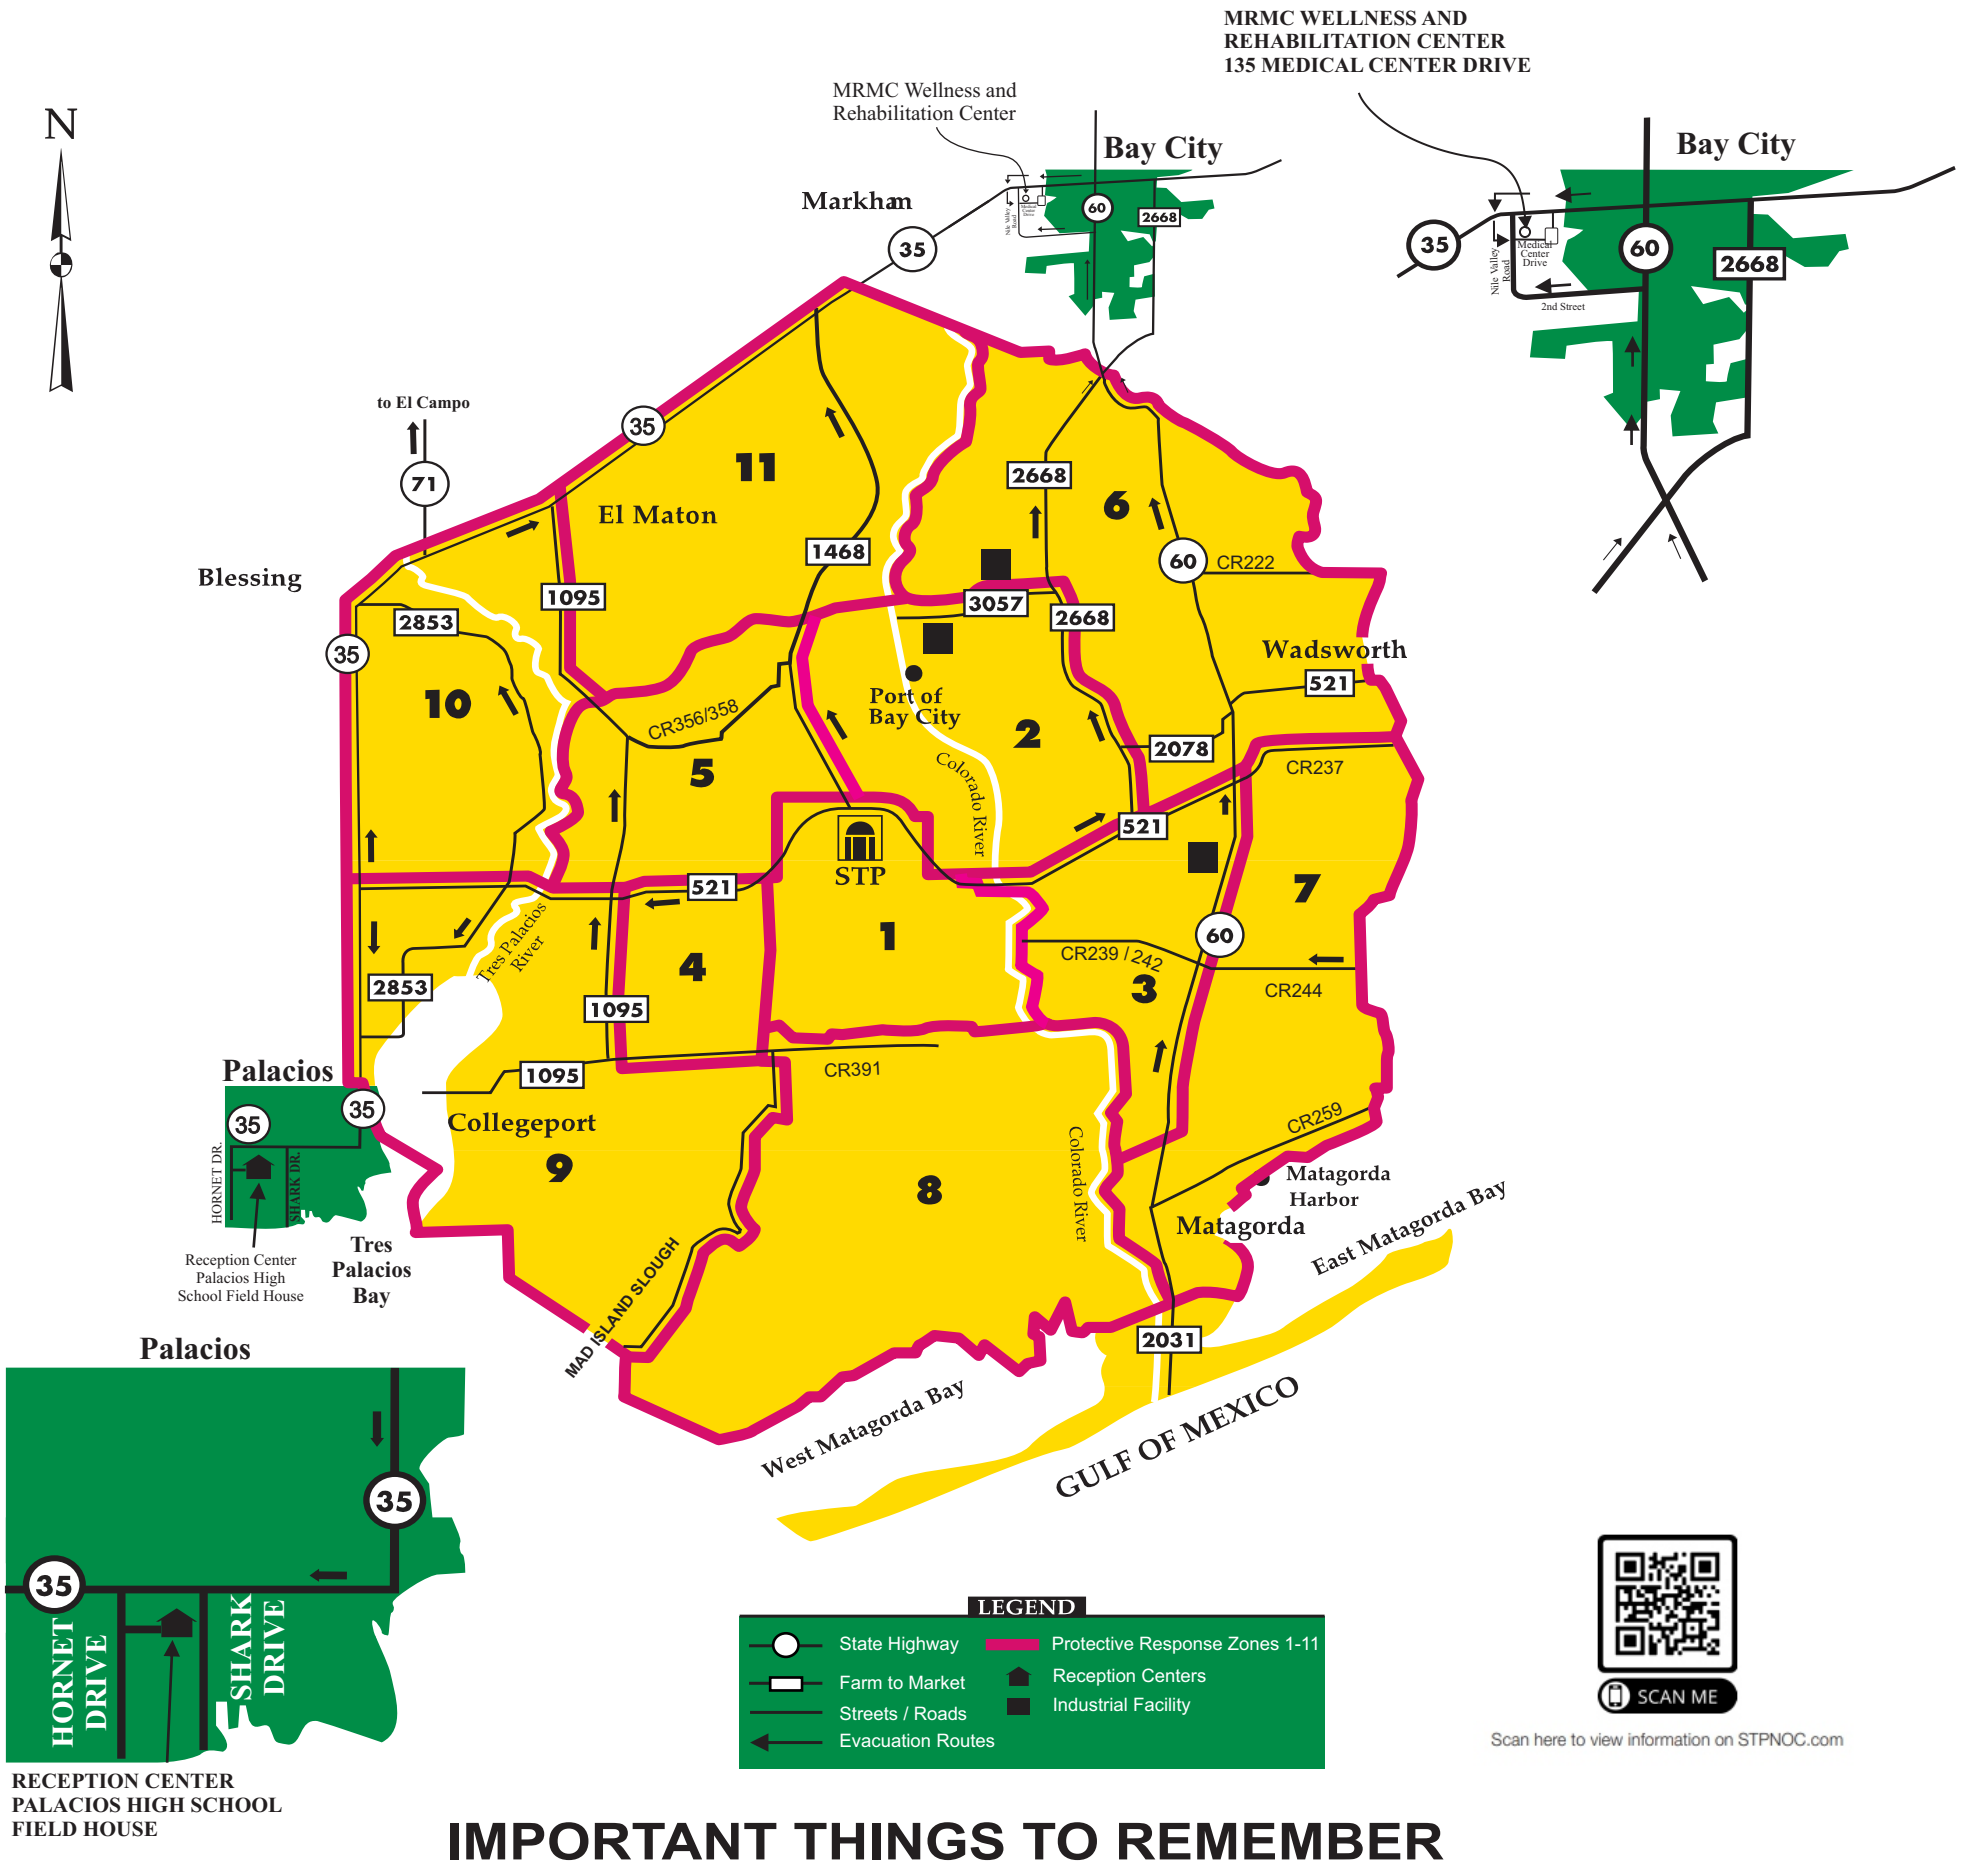

IMPORTANT THINGS TO REMEMBER

1. In case of a possible emergency, you may receive IPAWS alerts directly to your phone. An IPAWS alert is a Wireless Emergency Alert (WEA) that is received on your mobile device to inform you of any chemical spill, hurricane, tornado, flood, or problem at STP that may affect you. WEAs are free notifications that have a special tone and vibration.

2. Mobile devices that are IPAWS-WEA capable are typically automatically opted-in to receive alerts when first set up. Persons that have opted-out at some point will need to opt back in to receive emergency messages. Persons that do not do this are choosing to not receive emergency messages.

3. If you get a WEA, take any recommended action, and listen to the official Emergency Alert System (EAS) NOAA Radio at 162.425 or your local EAS radio station, KKHA FM 92.5 for official news and instructions from Matagorda County Office of Emergency Management.

4. If you are asked to SHELTER IN PLACE: Get inside the nearest building. Brick or concrete are best. Get as far into the middle of the building as possible. Take recommended actions and listen to NOAA Radio at 162.425 or your local EAS radio station, KKHA FM 92.5 for additional news and instructions.

5. If you are asked to EVACUATE: During an STP declared emergency, official messages over Emergency Alert System stations may direct you to report to one of the reception centers: MRMC Wellness and Rehabilitation Center in Bay City, or Palacios High School Field House in Palacios. Officials will determine which center is to be opened.

Important Telephone Numbers To Know

Matagorda County Office of Emergency Management

(979) 323-0707

For Special Assistance During Emergencies

(979) 245-5526

Joint Information Center

***(979) 244-5318**

**This number is activated during scheduled STP drills or for Matagorda County or STP events.*

Si tiene alguna pregunta, llamenos al teléfono (979) 245-5526.